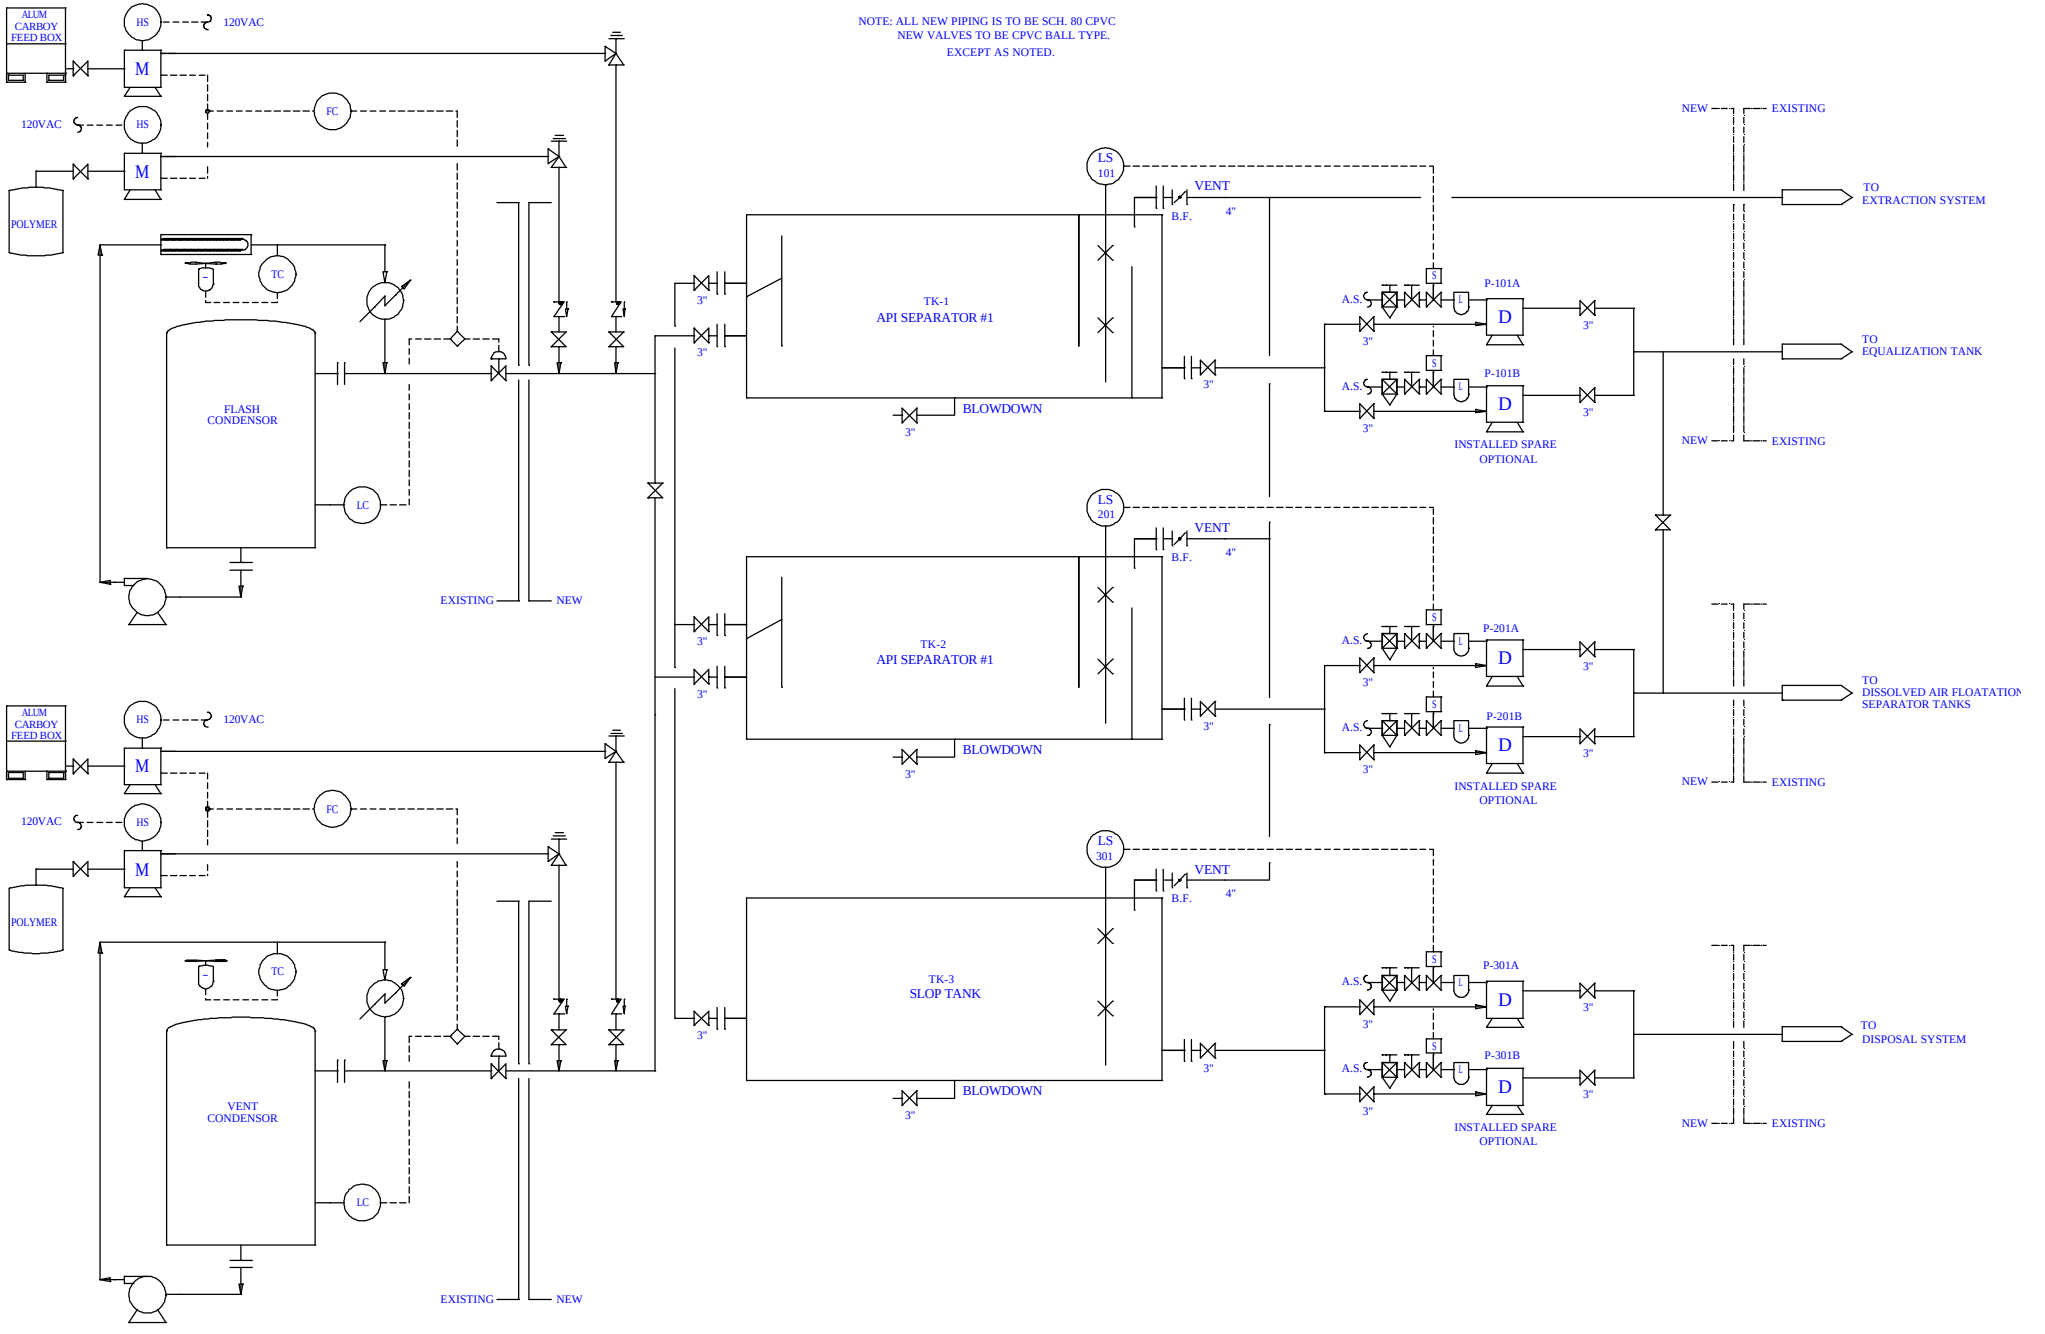
NOTE: ALL NEW PIPING IS TO BE SCH. 80 CPVC
NEW VALVES TO BE CPVC BALL TYPE.
EXCEPT AS NOTED.
ALUM CARBOY FEED BOX
HS
120VAC
M
FC
POLYMER
TC
FLASH CONDENSOR
LC
EXISTING
NEW
VENT CONDENSOR
TK-1
API SEPARATOR #1
TK-2
API SEPARATOR #1
TK-3
SLOP TANK
LS 101
LS 201
LS 301
VENT
B.F.
4"
3"
BLOWDOWN
A.S.
S
L
D
P-101A
P-101B
P-201A
P-201B
P-301A
P-301B
INSTALLED SPARE
OPTIONAL
TO
EXTRACTION SYSTEM
TO
EQUALIZATION TANK
TO
DISSOLVED AIR FLOATATION
SEPARATOR TANKS
TO
DISPOSAL SYSTEM